
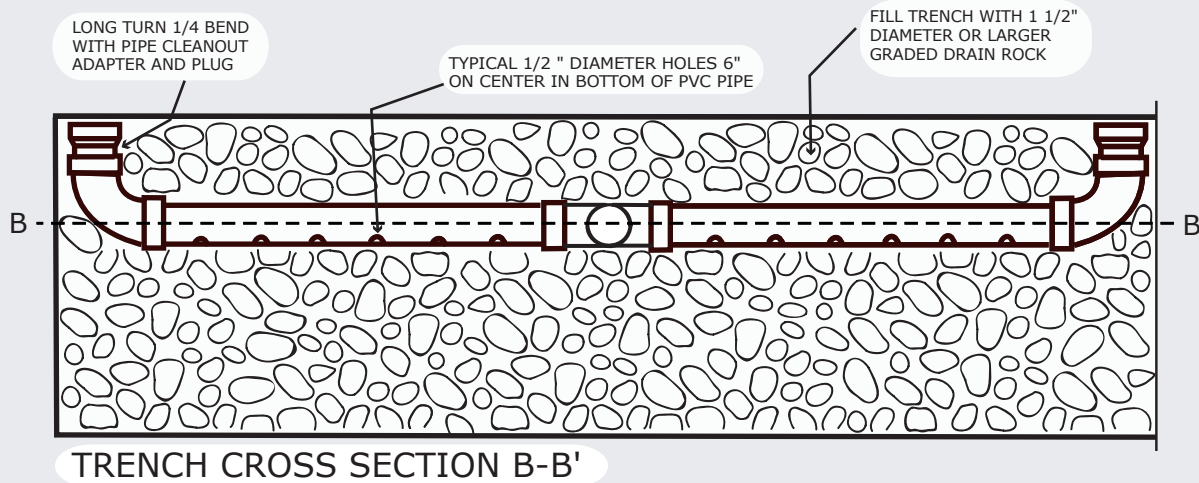
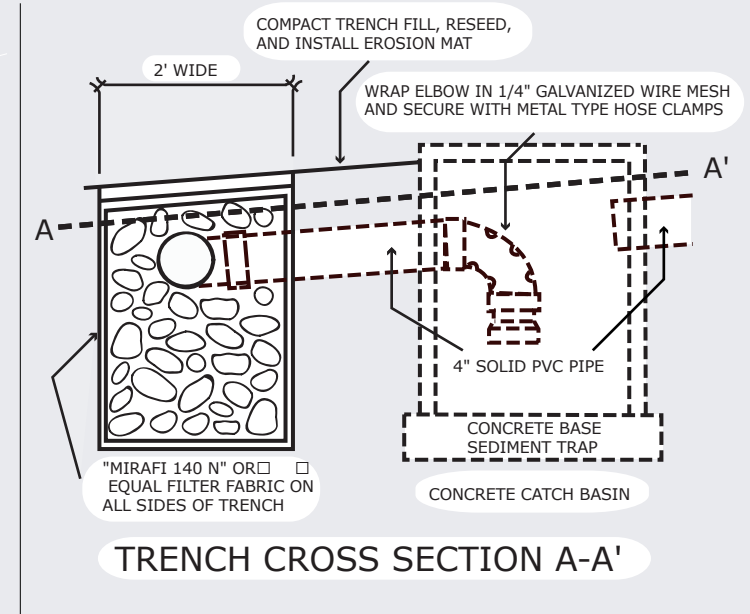


ROOF WATER DISPERSION OUTLET DETAIL

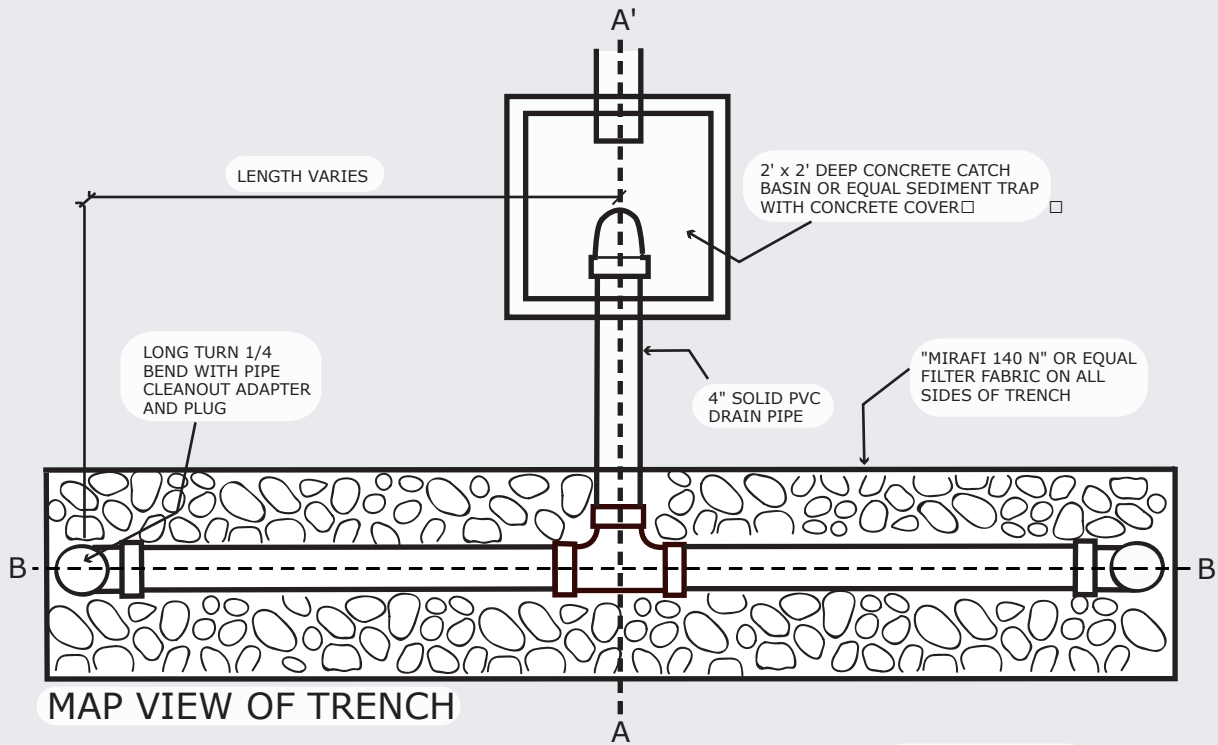

TRENCH DIMENSIONS

WIDTH _____

DEPTH _____

LENGTH _____

NOTES:

1. DISPERSION PIPE SHALL BE LEVEL AND TRENCH SHALL BE PARALLEL TO CONTOURS.
2. 'MIRAFI 140 N' OR EQUAL FILTER FABRIC SHALL BE INSTALLED ON SIDES, ENDS, TOP AND BOTTOM OF TRENCH.
3. DISPERSION TRENCH SHALL BE LOCATED 20 FEET, AT A MINIMUM, FROM ANY STRUCTURES.
4. DISPERSION TRENCH SHALL BE LOCATED ON THE LEAST STEEP AVAILABLE SLOPE.
5. DISPERSION TRENCH SHALL BE LOCATED AWAY FROM AND BELOW SEPTIC FIELDS.